




## Installation instructions

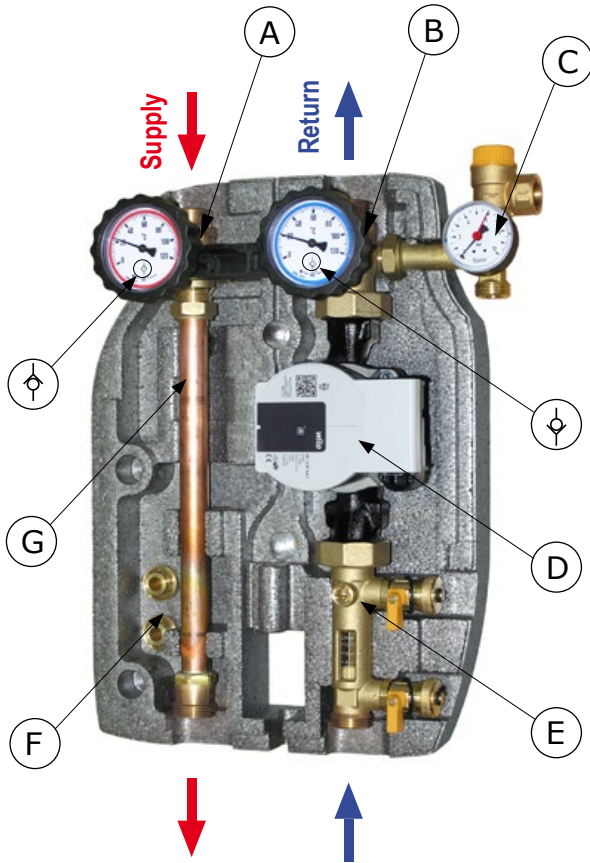


### DIMENSIONS

**EPP Insulation box:** it includes a control unit holder insert suitable for the passage of power cables and sensors. A dedicated opening allows to read the flow rate without removing the lid.

Dimensions: 308x434x169 mm.

*A special metal back plate fasten the unit to the insulation and allows easy installation both on the wall and on the water tank.*

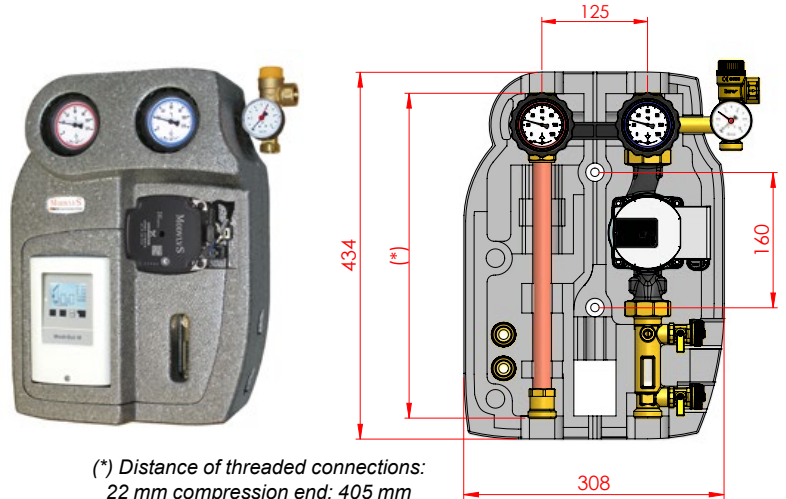

(\*) Distance of threaded connections:  
22 mm compression end: 405 mm  
3/4" M and 1" M: 385 mm

### MAIN COMPONENTS

- A. Supply ball valve provided with 10 mbar check valve which can be excluded, supplied with in-handle red ring thermometer, range 0-120°C.
- B. Return ball valve provided with 10 mbar check valve which can be excluded, supplied with in-handle blue ring thermometer, range 0-120°C.
- C. 6 bar safety unit with 0-10 bar pressure gauge with connection to the flexible hose of expansion vessel (not included).
- D. Synchronous high efficiency circulating pump externally controlled by PWM signal.
- E. Flowmeter with flow regulation with filling and draining valves.
- F. Pair of hose unions for filling and draining.
- G. Supply connection pipe.

### MAINTENANCE


To operate an incidental service/replacement of the circulating pump, close the ball valve (B) and regulation rod (E) by rotating clockwise. Once maintenance is over, open again the two ball valves and restore the pressure of the system.

### TECHNICAL FEATURES

PN 10. Constant temperature 120°C;  
(short time temperature: 160°C for 20 s).  
Available external connections:  
22 mm compression, 3/4" Male or 1" Male.

### FIELD OF USE


For power up to 50 kW.

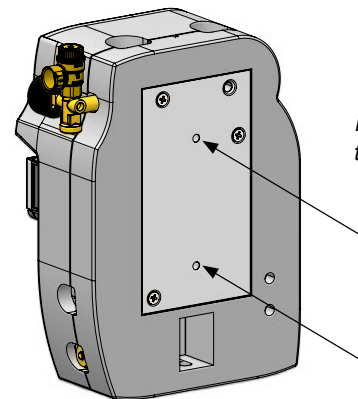

*Metal back plate to fasten the unit to a wall or to a water tank.*


*ø10 fastening holes on the back plate.*

*Special passages on the insulation allow fastening without having to disassemble the unit.*

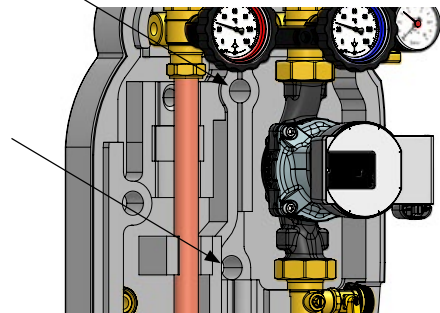


**SAFETY:** Temperatures reached by the fluid can be high enough to cause scalds and burns. The unit must be installed by a qualified installer. After the installation, check the tightness of the connections to avoid leaks during working operations.

# SOLAR PUMPING STATION S2 SOLAR 20

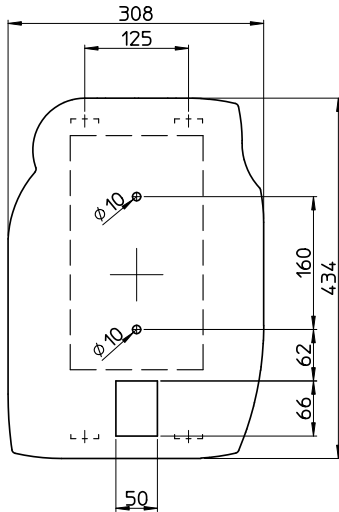


Cable passage for the sensor positioned on the solar collector.

Metal back plate to fasten the unit to a wall or to a storage tank.

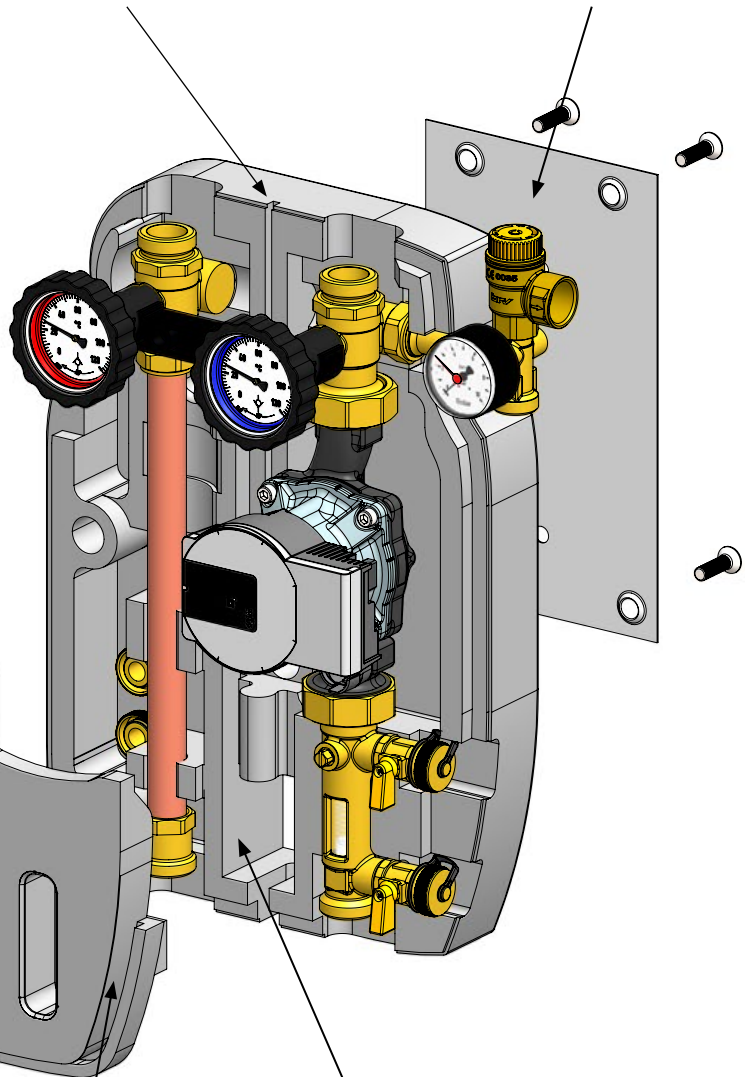

**Controller housing seat**  
On the side of the controller there is a special passage that allows the cables to reach the central cable exit compartment.

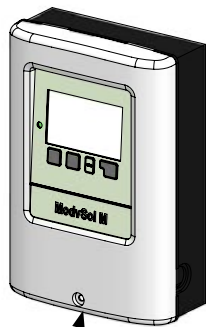

Controller wiring exit (sensors, power supply, circulating pump).

**Circulating pump cable**  
The controller insert offers a dedicated passage for the circulating pump's power cable. This seat extends along the external profile of the insert, normally covered by the insulation cover, and allows the cable to be guided along a well-defined path and isolated from heat sources.

**Wiring exit compartment**  
In this area, which is thermally insulated from the rest of the group, all the wiring and temperature probes are collected and sorted. Thanks to the double opening obtained in the insulation, the cables can come out both towards the bottom and towards the rear, depending on the installation needs.



**DANGER**

**Electric wiring.** The station is fully wired. Provide a Schuko type socket for connection to the electrical network.  
Voltage: 230 VAC +/- 10%. Frequency 50-60 Hz.



**NOTE:** For instructions regarding the installation and operation of the controller, refer to the specific manual included.

# SOLAR PUMPING STATION S2 SOLAR 20

## COMPONENTS AND OPERATION



### 10 mbar check valve

“Solar” check valve built-in in the ball valve, both in the supply and in the return way. It guarantees tightness and low pressure drops. To exclude the check valve, for example in case of draining the system, turn the handle 45° clockwise.



### Safety unit

The safety unit, CE and TÜV approved, protects the installation from overpressures. It is calibrated at 6 bar and over this pressure the unit intervenes. It is also provided with a  $\varnothing 50$  mm 0-10 bar pressure gauge and with a connection to the expansion vessel by means of a 3/4" flexible kit (optional).




**Safety unit:** the blow-off outlet is marked by an arrow on the body of the valve. Install a blow-off pipe such that neither injury to a person nor damage to property can be caused by the blow out liquid.



### Flowmeter regulator

The flowmeter allows to read the flow rate as well as to fill easily the system. Thanks to a 3-way ball, when the valve is closed the usual circulation is cut off and it is possible to use the side filling valve to fill the system. There is also another side valve, for the draining. The proximity of the two valves helps these operations, minimizing the distance between the filling and the draining. The flow rate is shown by the special sliding cursor. Four flowmeters are available with different intervals of measurement: 1-6 L/min, 2-12 L/min, 8-28 L/min and 8-38 L/min. The flowmeter regulator, and therefore the pumping unit, must be mounted only vertically.




The flow rate is shown taking as reference the lower edge of the sliding cursor.

**The integrated ball valve also allows fine adjustment of the system flow rate. However, it is recommended and preferable to adjust the flow rate by controlling the high efficiency synchronous circulating pump.**

## MOUNTING POSITION


To facilitate installation operations, the control unit holder insert can be temporarily housed in a lateral position. This device allows easy access to the filling valve, avoiding having to manually support the control unit: it is sufficient to use the 22 mm groove located in the lower area of the insert to hook the insert itself to the supply pipe. Once the installation operations have been completed, it is possible to reposition the control unit holder insert in its final housing.

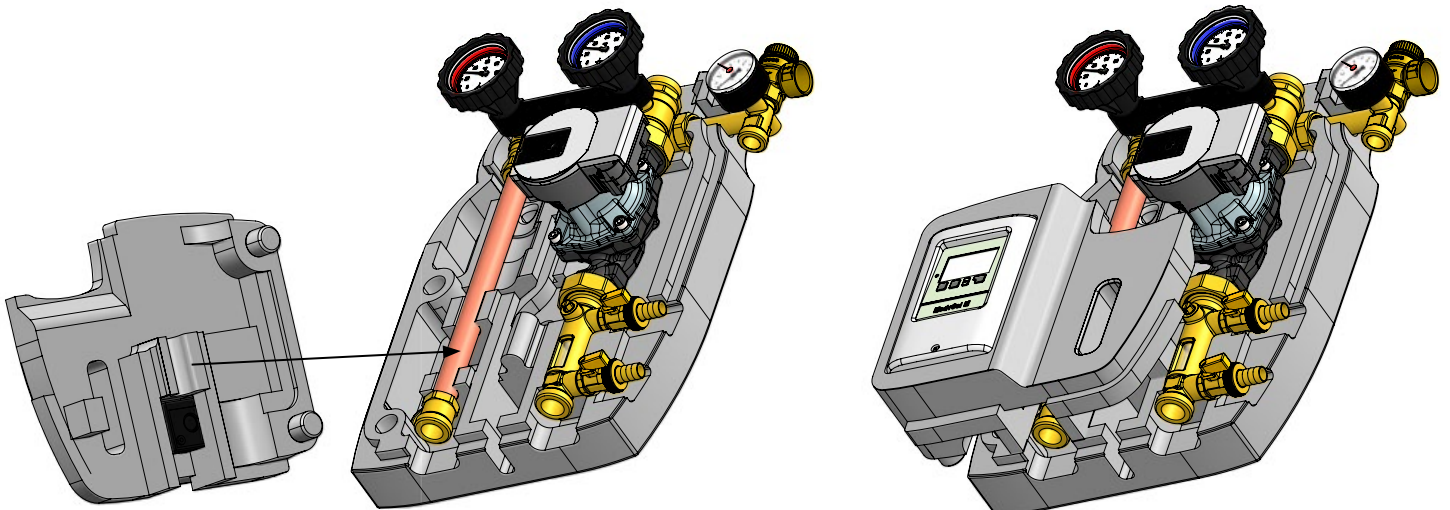

# SOLAR PUMPING STATION S2 SOLAR 20

## FILLING THE SYSTEM


1. Check the connections to the circuit and to the expansion vessel;
2. Make sure both ball valves (A) and (B) are open;

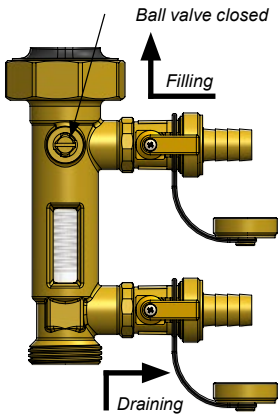

3. Remove the plugs from the side valves and connect the hose unions, by connecting them to the filling device of the system;

4. Close the flowmeter ball valve and open the side filling and draining valves;


5. Fill the system up to a pressure level set by the project;

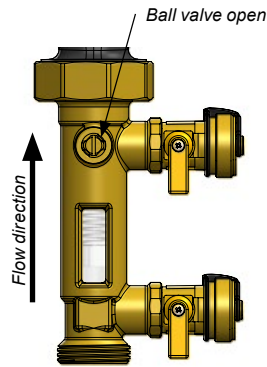

6. Close side valves, remove hose unions and re-screw plugs;

7. To avoid any accidental opening of the side taps it is advisable to block the levers in the closed position as illustrated alongside;

8. Reopen the ball valve of the flow meter;

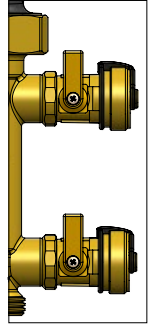

*Blocking the filling/draining levers: unscrew the fixing screw, take out the lever and place it again turning it by 180°.*

9. Start the circulating pump and check that there are no leaks from the connections;
10. After a few minutes of circulation, deaerate the circuit;
11. Adjust the flow rate of the circuit, preferably by acting on the control of the high efficiency synchronous circulating pump, alternatively carry out the adjustment by acting on the ball valve of the flow meter, until the desired flow rate is read on the indicator;
12. After a few hours of operation, check again the system pressure, the tightness of the connections and repeat deaeration.